


TOP VIEW

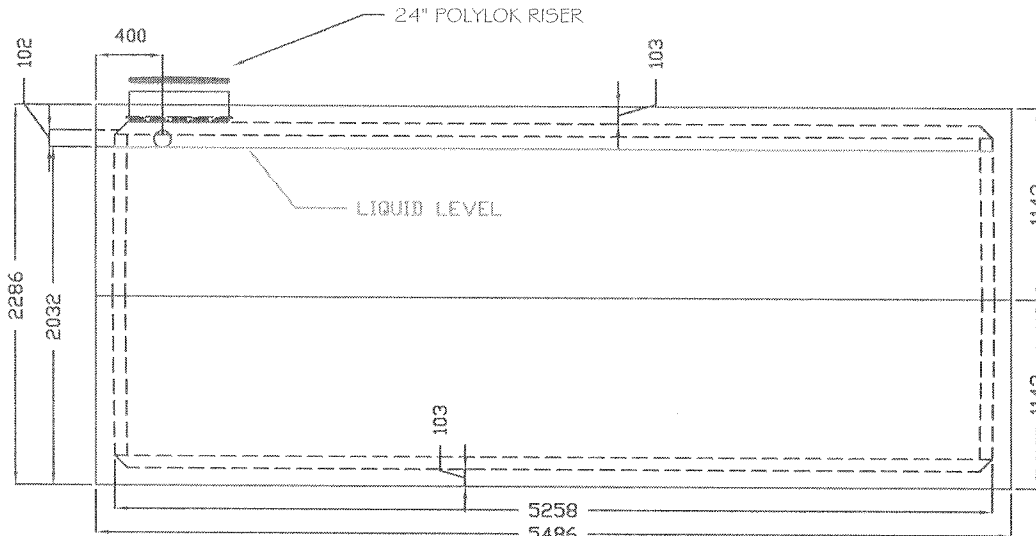

SIDE VIEW

DIMENSIONS:

ALL DIMENSIONS IN MILLIMETERS  
 +/- 10mm TOLERANCES ON ALL DIMENSIONS

CONCRETE:

STANDARD  
 STANDARD ACC(ACCELERATED STRIPPING)  
 10 MPa STRIPPING STRENGTH  
 35 MPa @ 28 DAYS  
 C-1 EXPOSURE CLASS  
 SULPHATE RESISTANT  
 3.9 CUBIC YARDS (TOP HALF)  
 3.9 CUBIC YARDS (BOTTOM HALF)

REINFORCEMENT:


ALL REINF. HAS MIN. 25mm OF COVER  
 10M @ 300mm O/C E/W  
 CORNER BARS AROUND RISERS

WEIGHT:

EACH SECTION APPROX. 16991 LBS/7723 KG  
 ASSEMBLED WEIGHT APPROX. 33982 LBS/15447 KG

NOTES:

JOINT SEALANT IS MASTIC SEALANT (CONSEAL CS-102)  
 (NSF APPROVED SEALANT AVAILABLE FOR POTABLE WATER HOLDING TANKS)  
 TANK ASSEMBLED ON SITE  
 SEE INSTRUCTIONS FOR ASSEMBLY PROCEDURES  
 1.5M MAXIMUM BURIAL  
 INLETS ARE 4" POLYLOK PIPE SEALS  
 LID AND RISER ARE 24" DIAMETER POLYLOK

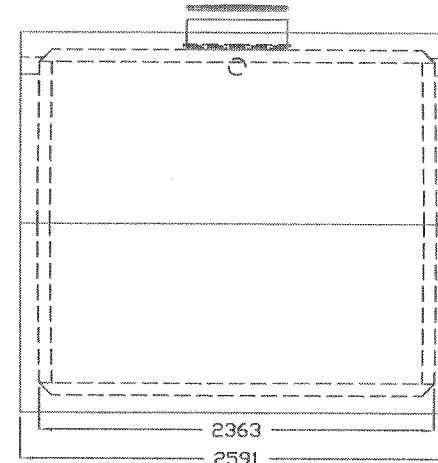

END VIEW



58 COOPER ROAD  
 ROSSLYN, ONT.  
 Phone: (807) 939-2655  
 Fax: (807) 939-1788

PRODUCT

5000 GAL/ 22750 L  
 HOLDING TANK

JOB/PRODUCT CODE:

5000HTPR

CONTRACTOR:

SCALE:

N.T.S

DATE	INI.	DESCRIPTION
NOV 2013	MH	ORIGINAL DRAWING